

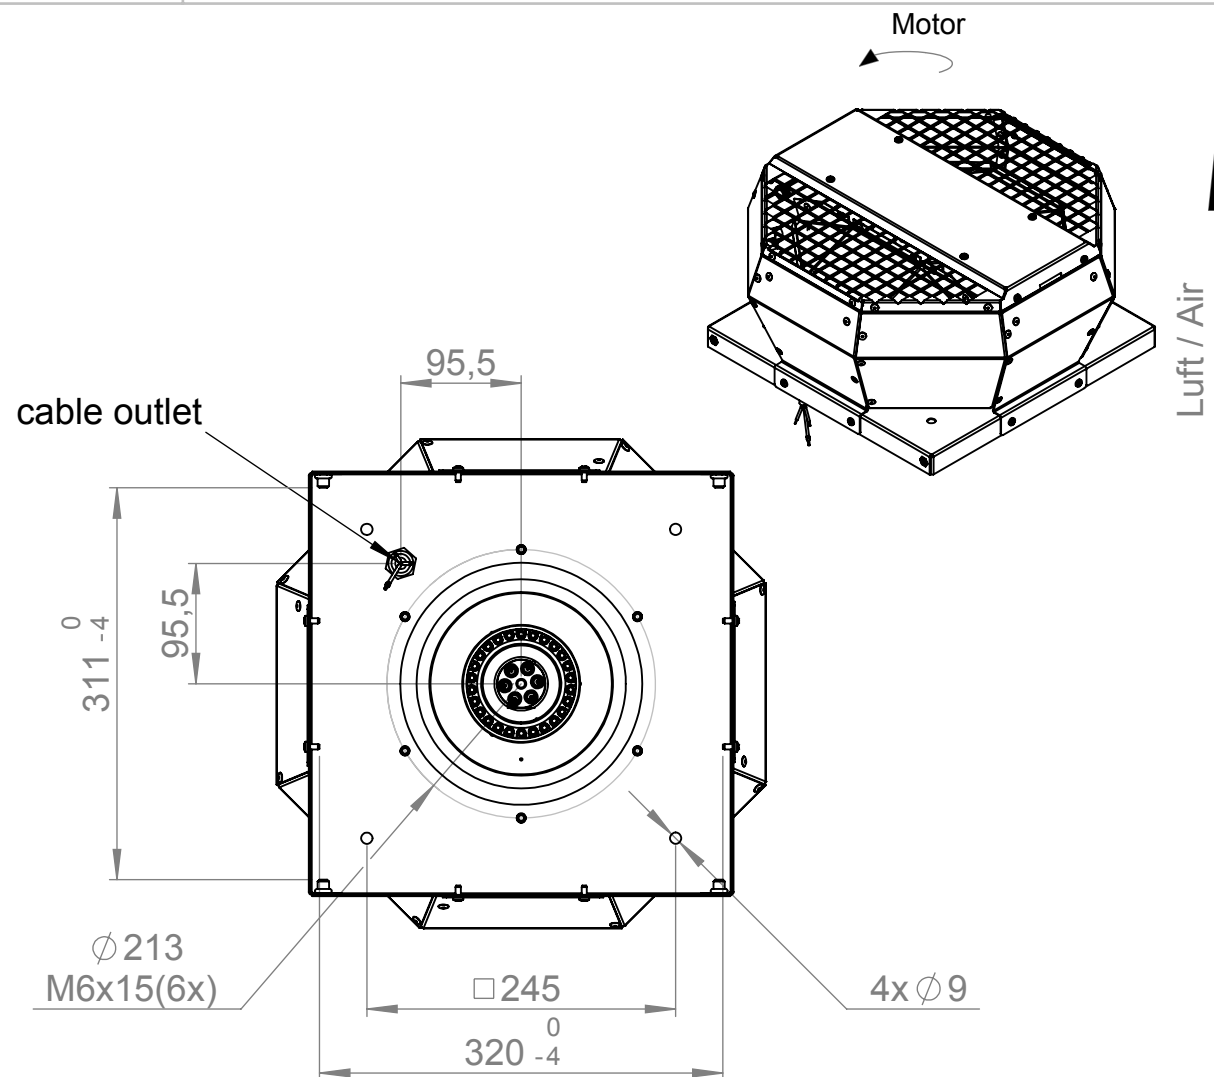


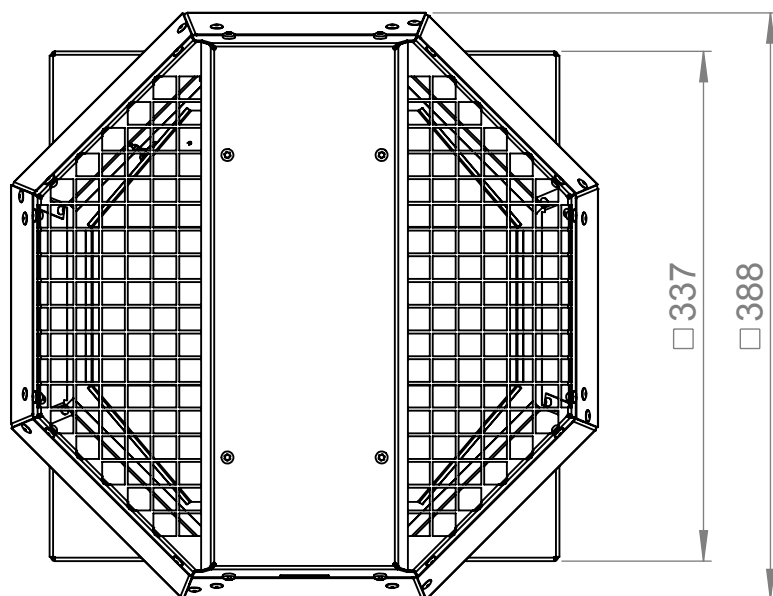

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

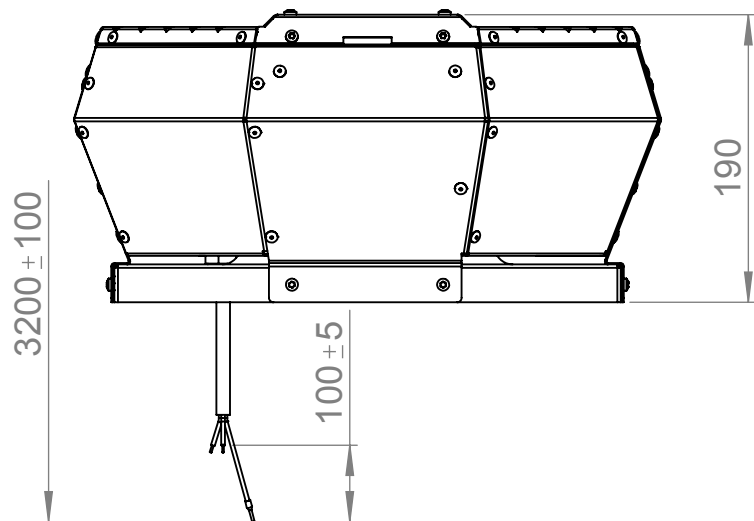

Protection Mark
according to ISO16016

1:5 A4 mm

General tolerances
DIN ISO 2768-mK

DVA250E420

Drawn: d.hancu
Created: d.hancu
Changed:

26.06.14
26.06.14

130440 00